

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 3394 (1985): Method for Accelerated Life Test of Electrical Resistance Alloys for Heating Elements [MTD 3: Mechanical Testing of Metals]



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam


“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



Indian Standard
METHOD FOR
ACCELERATED LIFE TEST OF
ELECTRICAL RESISTANCE ALLOYS FOR
HEATING ELEMENTS
(*First Revision*)

UDC 669'018'5 : 621'315'551 : 620'169'1/2



© Copyright 1985

INDIAN STANDARDS INSTITUTION
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Indian Standard

METHOD FOR ACCELERATED LIFE TEST OF ELECTRICAL RESISTANCE ALLOYS FOR HEATING ELEMENTS (First Revision)

Methods of Physical Tests Sectional Committee, SMDC 3

Chairman

SHRI P. K. CHAKRAVARTY

Representing

The Tata Iron & Steel Co Ltd, Jamshedpur

Members

SHRI R. K. ABROL	Bharat Steel Tubes Ltd, Ganaur
SHRI S. BONDE (Alternate)	
SHRI SUJIT KUMAR BASU	M. N. Dastur & Co (P) Ltd, Calcutta
SHRI S. SEN GUPTA (Alternate)	
SHRI K. K. BHATIA	Quality Marking Centre, Amritsar
SHRI R. N. BISWAS	Steel Authority of India Ltd (Durgapur Steel Plant), Durgapur
SHRI T. S. TEWARI (Alternate)	
DR A. CHAKRABORTY	Usha Martin Industries Ltd, Calcutta
SHRI H. MAHESWARY (Alternate)	
SHRI K. K. CHERIAN	Indian Aluminium Co Ltd, Calcutta
SHRI PANKAJ DE (Alternate)	
DR R. P. DAMBAL	Indian Telephone Industries Ltd, Bangalore
SHRI V. V. PRABHU (Alternate)	
SHRI M. K. DAS GUPTA	National Physical Laboratory (CSIR), New Delhi
SHRI K. G. GARG	Directorate General of Technical Development and Production (Air), New Delhi
SHRI P. RAGHOTHAMA RAO (Alternate)	
SHRI B. G. GEHANI	Blue Star Limited, Bombay
SHRI G. S. SOBTI (Alternate)	
SHRI A. GHOSH	National Test House, Calcutta
SHRI D. S. MAJUMDAR (Alternate)	

(Continued on page 2)

© Copyright 1985

INDIAN STANDARDS INSTITUTION

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

(Continued from page 1)

Members

Representing

SHRI S. A. HAQUE	The Tata Iron and Steel Co Ltd, Jamshedpur
SHRI A. S. WALIA (<i>Alternate</i>)	
SHRI N. C. HORE	Ministry of Railways
SHRI S. R. DE (<i>Alternate</i>)	
SHRI S. V. KULKARNI	Fuel Instruments & Engineers Pvt Ltd, Ichalkaranji
SHRI J. V. KULKARNI (<i>Alternate</i>)	
SHRI S. KUMAR	Mining & Allied Machinery Corporation Ltd, Durgapur
SHRI K. S. LAKSHMINARAYAN	Avery India Ltd, Calcutta
SHRI R. D. SHARMA (<i>Alternate</i>)	
SHRI C. B. LUNAWAT	The Indian Tube Co Ltd, Jamshedpur
SHRI R. RAMA RAO (<i>Alternate</i>)	
SHRI S. R. MAZUMDAR	Ministry of Defence (DGI)
SHRI A. K. CHAKROBORTY (<i>Alternate</i>)	
SHRI V. N. NANDA	Associated Instrument Manufacturers' (India) Pvt Ltd, New Delhi
SHRI S. C. JAIN (<i>Alternate</i>)	
SHRI R. A. PADMANABHAN	Central Mechanical Engineering Research Institute (CSIR), Durgapur
SHRI M. PRASAD	Steel Authority of India Ltd (Rourkela Steel Plant), Rourkela
SHRI N. GOPALAKRISHNA (<i>Alternate</i>)	
SHRI S. RADHAKRISHNAN	National Aeronautical Laboratory (CSIR), Bangalore
DR V. SRINIVASAN (<i>Alternate</i>)	
DR V. RAO	National Metallurgical Laboratory (CSIR), Jamshedpur
DR D. J. CHAKRAVARTI (<i>Alternate</i>)	
SHRI R. N. SAHA	Directorate General of Supplies and Disposals, New Delhi
SHRI S. K. PANDEY (<i>Alternate</i>)	
SHRI D. N. SARKAR	Ordnance Factories Board (Ministry of Defence), Calcutta
SHRI A. R. BASU (<i>Alternate</i>)	
SHRI F. C. SHARMA	Directorate General of Civil Aviation, New Delhi
SHRI K. SWAMIAPPAN	Ministry of Defence (R & D)
SHRI H. K. TANEJA	Indian Register of Shipping, Bombay
SHRI S. KUMAR (<i>Alternate</i>)	
SHRI YADHIVIR SINGH	Steel Authority of India Ltd (Bokaro Steel Plant), Bokaro
SHRI P. N. TRIPATHI (<i>Alternate</i>)	
SHRI K. RAGHAVENDRAN, Director (Struc & Met)	Director General, ISI (<i>Ex-officio-Member</i>)

Secretary

SHRI JAGMOHAN SINGH
Deputy Director (Metals), ISI

Indian Standard

METHOD FOR ACCELERATED LIFE TEST OF ELECTRICAL RESISTANCE ALLOYS FOR HEATING ELEMENTS (*First Revision*)

0. FOREWORD

0.1 This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 28 February 1985, after the draft finalized by the Methods of Physical Tests Sectional Committee had been approved by the Structural and Metals Division Council.

0.2 This standard was first published in 1965. In this revision the life of the heating element under the prescribed conditions of the test shall be determined at three different temperatures, namely, 1 150, 1 100 and 1 050°C. The selection of the particular material would be made by the user on the basis of indigenous availability, cost and reliability for continued service.

0.3 Nickel-chromium, nickel-iron-chromium, iron-chromium-aluminium alloys, etc, having high resistance to oxidation at elevated temperatures and are widely used for heating elements. The heating elements made of these alloys are suitable for heating devices, such as toasters, percolators, iron machines, heater pads and for electrical applications, namely, high-resistance rheostats and radio and moving-picture equipment, potentiometers, thermocouples and resistors. Method for carrying out the accelerated life test for these heating elements is covered in this standard.

0.4 For accuracy in test results some precautions are required to be observed while carrying out the test. Such precautions are described in Appendix A of this standard.

0.5 In reporting the result of a test or analysis made in accordance with this standard, if the final value, observed or calculated, is to be rounded off, it shall be done in accordance with IS : 2-1960*.

*Rules for rounding off numerical values (revised).

1. SCOPE

1.1 This standard prescribes the method for carrying out accelerated life test for determining the resistance to oxidation of iron-chromium-aluminium, nickel-chromium and other electrical heating alloys at elevated temperatures under intermittent heating.

2. PRINCIPLE OF TEST

2.1 The test consists of heating a wire or strip of suitable length and cross-section, at 1 150, 1 100 and 1 050°C, by passing ac or dc until the wire/strip burn out or for a period of 100 hours, whichever is less. The current is alternately put on for two minutes and put off for two minutes. The wire or strip shall be made in the form of U shape, connected between two terminals spaced at a given distance.

3. TEST PANEL

3.1 Size and Location — The dimensions of the test panel shall conform to those shown in Fig. 1. The test panel shall be located in a position free from draughts of air.

3.2 Terminals — The two terminals shall be spaced 50 mm apart from centre-to-centre and shall be in a U-shaped pattern as described in 6. The specimen terminal junctions shall be 75 mm lower than the plane of the top of the enclosure.

3.3 Screen — A screen of 425 μ m with 0.30 mm wire diameter, shall be used as a cover over each mounted panel.


4. TESTING APPARATUS

4.1 The apparatus shall consist of the following and shall be connected as shown in Fig. 2.

4.1.1 Power Supply — The transformer or motor generator set shall be capable of delivering a controlled voltage from 10 to 35 V to the circuit. It shall have a continuous current capacity of at least 20A per specimen.

4.1.2 Voltage Control — The automatic voltage control shall be capable of maintaining across the bus bars a constant voltage within ± 0.5 percent.

4.1.3 Rheostat — The rheostat shall be capable of adjusting the current through the specimen to within approximately 0.25 percent of any desired value within the working range and shall have a continuous current rating of approximately 25A.

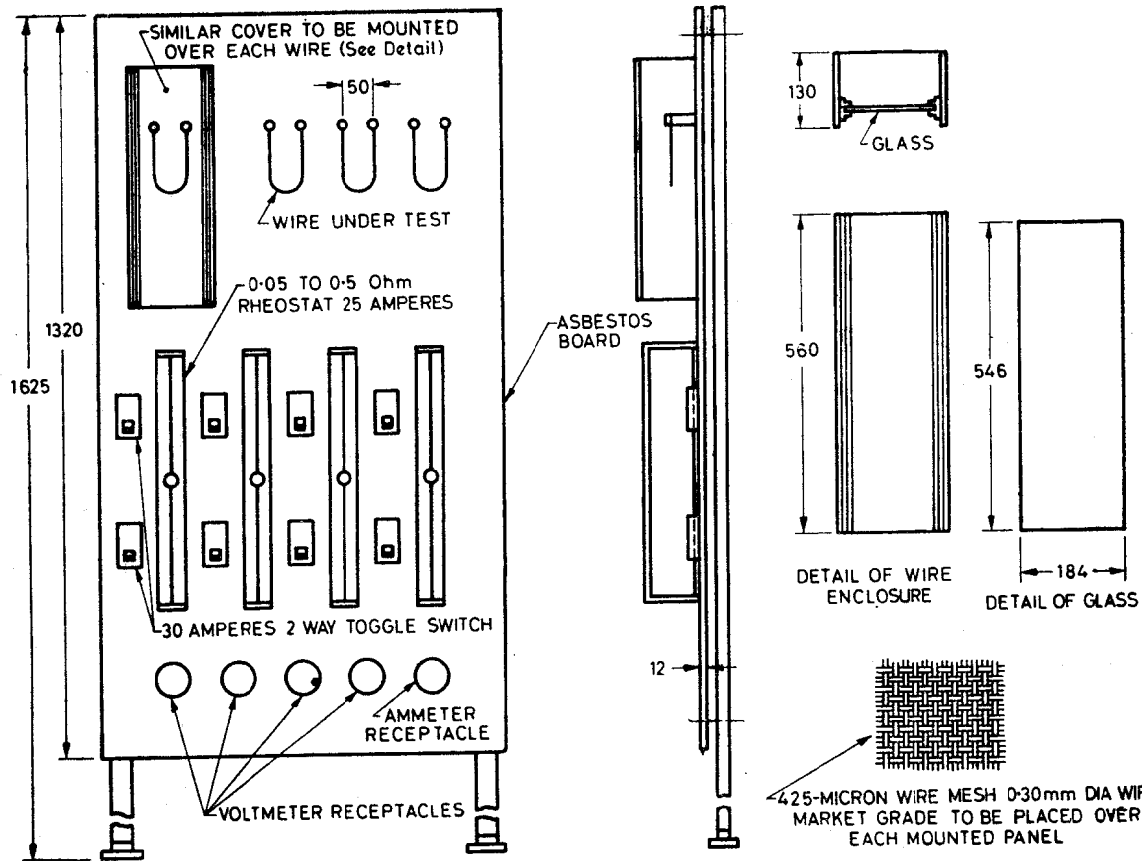

All dimensions in millimetres.

FIG. 1 TEST PANEL

4.1.4 Ammeter and Voltmeter — The ammeter and voltmeter shall have an accuracy of one percent of normal test deflection (approximately 15 A and 15 V respectively). For alternating current the range shall be such as to give a reading above the lower fifth of the scale range. A compensating resistance shall be cut into the circuit to replace the resistance of the ammeter so that the overall resistance of the circuit is not changed. This resistance shall be inserted in series with the contact of the upper switch as shown in Fig. 2.

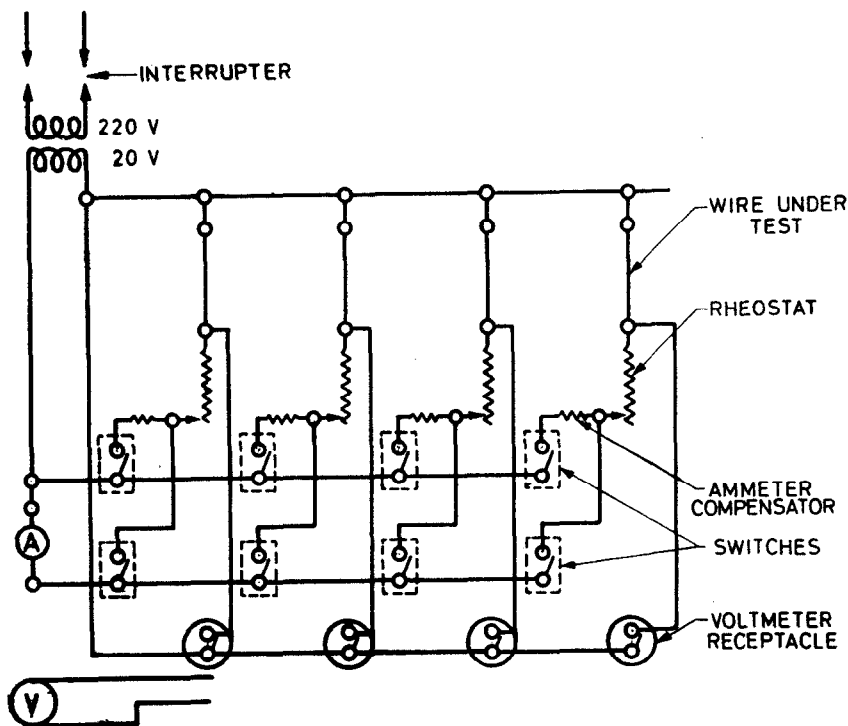


FIG. 2 ELECTRICAL CIRCUIT DIAGRAM FOR ACCELERATED LIFE TEST

4.1.5 Optical Pyrometer — The optical pyrometer shall be of the disappearing filament type. The optical system shall be such as to provide a magnification of at least four diameters. This may be accomplished by means of a special lens or combination of two standard lenses in the objective to provide a short focal length and the desired magnification.

4.1.6 Interrupter — A suitable apparatus shall be used as interrupter to open and close the circuit.

4.1.7 Apparatus for Recording Life Time — If no apparatus is available for recording the life time arrangements shall be made for hourly observations of the specimen. Small thermocouples made from fine wire may be attached to the test panel and the hot junction placed near the specimen under test. A multiple-point recording pyrometer may be attached to the thermocouples, which will give a complete record of the number of cycles.

5. TEST SPECIMEN

5.1 The test specimen shall be in the form of wire, tape or strip and shall have an electrical resistivity within the specified limits for the alloy being tested. The length of the specimen shall be 250 mm between the two terminals.

5.1.1 The test specimen shall be representative as regards the surface of the average of the coil or spool of wire/strip which has been selected for test. Particular care shall be taken to see that the specimen selected is free from kinks. The precaution is necessary, since a kink, even though later removed, may cause burn out at that point.

6. MOUNTING SPECIMEN

6.1 A straight length of the specimen shall be formed into a U pattern, 250 mm of which shall be mounted between the terminals as described in 3.2. The U pattern shall consist of two parallel legs and a semi-circle of 25 mm radius, the plane of which is parallel to and equidistant from the front and back panels, and the legs of which are equally spaced from the side panels.

7. BALLAST RESISTANCE

7.1 The ballast resistance in series with the specimen shall be at least 60 percent of the specimen resistance at the beginning of the test, but shall not be greater than the specimen resistance.

8. TEMPERATURE OF TEST

8.1 The life test shall be carried out at three different temperatures, namely, at 1 150, 1 100 and 1 050°C for a period of 100 hours or until burn out, whichever is less.

9. TEST PROCEDURE

9.1 The filament current of the optical pyrometer shall be adjusted to the value corresponding to the required test temperature specified in 8.

9.2 The switches should be so adjusted that the voltmeter and ammeter are in circuit while the temperature is being adjusted. The pyrometer telescope shall be supported in such a way that it can be quickly adjusted and read. The interrupter shall not be in operation while the temperature is being adjusted.

9.3 The series rheostat shall then be set at a maximum resistance and the switch in series with the specimen shall be closed and the time shall be recorded. The resistance in the rheostat shall be cut out rapidly until the specimen is at a low red heat. The rheostat slider shall be adjusted until the specimen exactly matches the lamp filament of the pyrometer corresponding to the test temperature in brightness. This adjustment should be done until one and a half minutes have elapsed from the starting of the test.

9.4 The test shall be allowed to continue until 14 minutes have elapsed from the time of starting the test. Then, after carefully resetting the current in the optical pyrometer, the temperature of the specimen shall be readjusted to the test temperature. Final adjustment shall be completed within 15 minutes from the time of starting the test. It is extremely important that the time schedule specified rigidly adhered to. If a greater amount of time than that specified is taken to make the adjustments, the specimen shall be discarded, another one put in its place and the test started again.

9.5 The voltage and the current, together with the starting temperature and the starting time shall be recorded at the end of the 13 minutes period.

9.6 The interrupter shall then be started. The timing device of the interrupter shall be previously regulated so that the 'on' period and the 'off' period shall be equal and each shall have a duration of 2 minutes.

9.7 The temperature shall be adjusted to the test temperature after 5 h and 24 h total elapsed time and the voltage and current shall be recorded after each resetting. Before each resetting the interrupter shall be stopped and after making the observation, it shall be started again.

9.8 After the first 24 h period and each 24 h thereafter, the temperature of the specimen shall be adjusted and after each temperature adjustment, the voltage and current shall be recorded. In determining the temperature, if the wire/strip has developed a 'hot spot', the pyrometer shall be focussed on a section of the wire or strip showing even emission. The time of appearance of the 'hot spot' shall be recorded.

9.9 The resistance at 72 h and 96 h shall be determined, if 'burn out' has not taken place. This will indicate the rate of growth of 'hot spot' in case it has appeared.

10. TEST REPORT

10.1 The test report shall include the following:

- a) Nominal composition of the heating elements,
- b) Identification of specimen,
- c) Cross-sectional dimensions of the specimen,
- d) Temperature of test,
- e) Life of the specimen in h (total elapsed time from the end of the first 15 minute aging period to burn out if the burn out takes place before in 100 h. In case of specimens where burn out does not take place during in 100 h testing, the life of the specimen may be indicated as 100 h),
- f) The time of the first formation of a 'hot spot',
- g) The increase in resistance in 72 h and 96 h,
- h) The increase in resistance as noted for the last resistance reading before burn out,
- j) A curve showing the relation between resistance and time, and
- k) A description of the physical condition of the specimen after completion of the test.

11. REPRODUCIBILITY

11.1 In this test method, the major source of irregularity is in respect to temperature measurement. Therefore, no attempt shall be made to run standard accelerated life tests until consistent results are obtained with specimens taken from the same sample coil or spool. Four or five specimens shall be tested at the same time to make sure that no variables, such as errors in temperature measurement, would affect one test and not another. Consecutive tests shall also be run. If the tests are properly made and controlled, the life of a number of specimens cut from the same spool should not vary more than ± 10 percent from the average. It is desirable to select and keep as a reference standard for comparison a spool of wire/strip that is uniform in cross-section from one end to the other. Tests may then be made at any time on reference standard and any change in life of standard at different times due to changed conditions may be correlated with the results on other wires/strips.

APPENDIX A

(Clause 0.4)

PRECAUTIONS TO BE OBSERVED IN SETTING UP AND OPERATION OF THE LIFE TEST EQUIPMENT

A-1. TEMPERATURE

A-1.1 Temperature is one of the most important variables in a life test. The probable life of a wire/strip varies inversely with an exponential function of the temperature.

A-1.2 To determine the temperature accurately, the disappearing filament type optical pyrometer may be used and the desired magnification can be obtained by substituting for the standard objective lens, another lens having approximately one half its focal length. The temperature of the wire/strip under test is very greatly affected by draughts. The enclosure, therefore, should be left in place at all times during temperature observation and the pyrometer reading made directly through the glass front of the enclosure. In taking this reading through the glass front, it is necessary to allow for the reflection and absorption of the glass. Reflection on the surface of the glass is the principal cause of the error. This effect is nearly independent of the kind and thickness of the glass. Reflection from external light sources shall be avoided. A correction as determined by a specific test for the conditions involved shall be added to the temperature as observed. The glass slide shall be kept clean at all times to avoid increase in the absorption of light.

A-2. VOLTAGE CONTROL

A-2.1 It is not possible to get uniform results using the regular line voltage with no regulation. It is, therefore, essential that voltage control be used.